
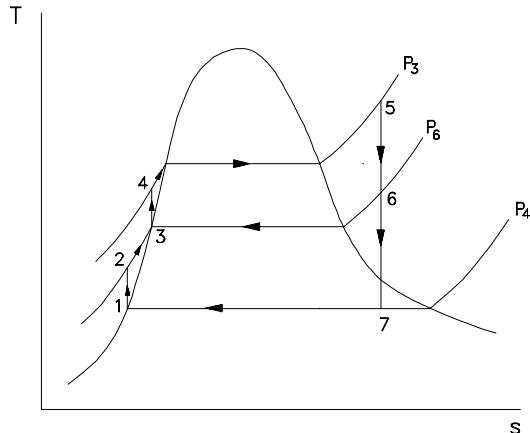


## Week 4: Lecture 3

## Rankine Cycle with Regeneration

- Carnot cycle has efficiency -  $\eta = 1 - T_L/T_H$ 
  - add  $Q_H$  at as high a  $T_H$  as possible
  - reject  $Q_L$  at as low a  $T_L$  as possible
- the Rankine cycle can be used with a “Feedwater Heater” to heat the high pressure sub-cooled water at the pump exit to the saturation temperature
  - most of the heat addition ( $Q_H$ ) is done at high temperature

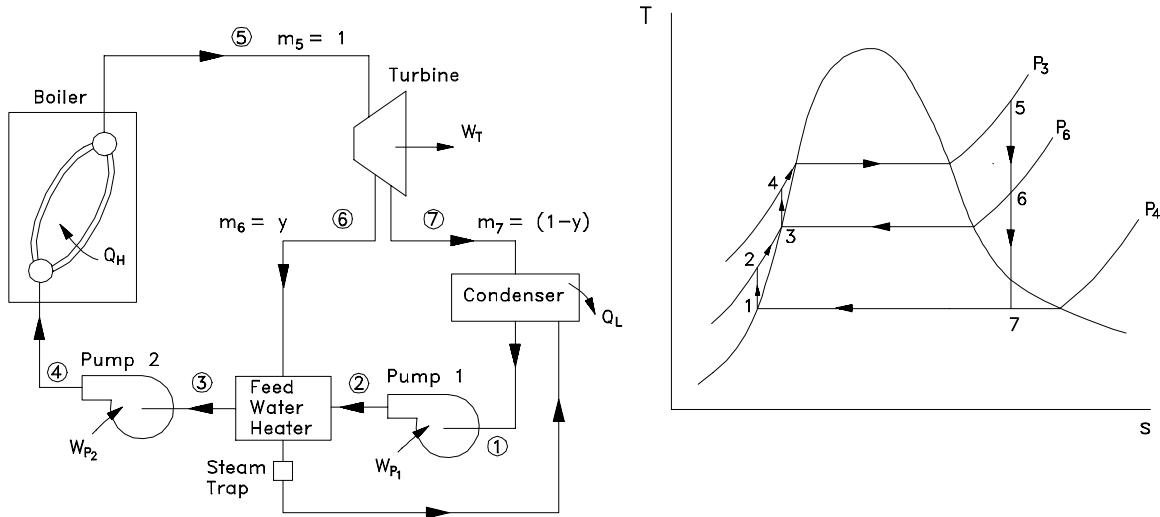

**Week 4: Lecture 3****Feedwater Heaters**

1. **OPEN FWH** - streams mix → high temperature steam with low temperature water at constant pressure)
  - working fluid passes isentropically through the turbine stages and pumps
  - steam enters the first state turbine at state 1 and expands to state 2 - where a fraction of the total flow is bled off into an open feedwater heater at  $P_2$
  - the rest of the steam expands into the second stage turbine at state point 3 - this portion of the fluid is condensed and pumped as a saturated liquid to the FWH at  $P_2$
  - a single mixed stream exists the FWH at state point 6
2. **CLOSED FWH** - heat exchangers, streams do not mix (different pressures)
  - the incoming feedwater does not mix with the extracted steam
  - both streams flow separately through the heater
  - this allows the two streams to be at different pressures
  - a steam trap which allows only liquid to pass, is inserted in the condensed steam line, leaving the heater to insure all the extracted steam condenses before it leaves the heater
  - the condensate is then passed to the low pressure line of the condenser